


RAVEN ISO PRODUCT CONTROL WITH ISO INJECTION

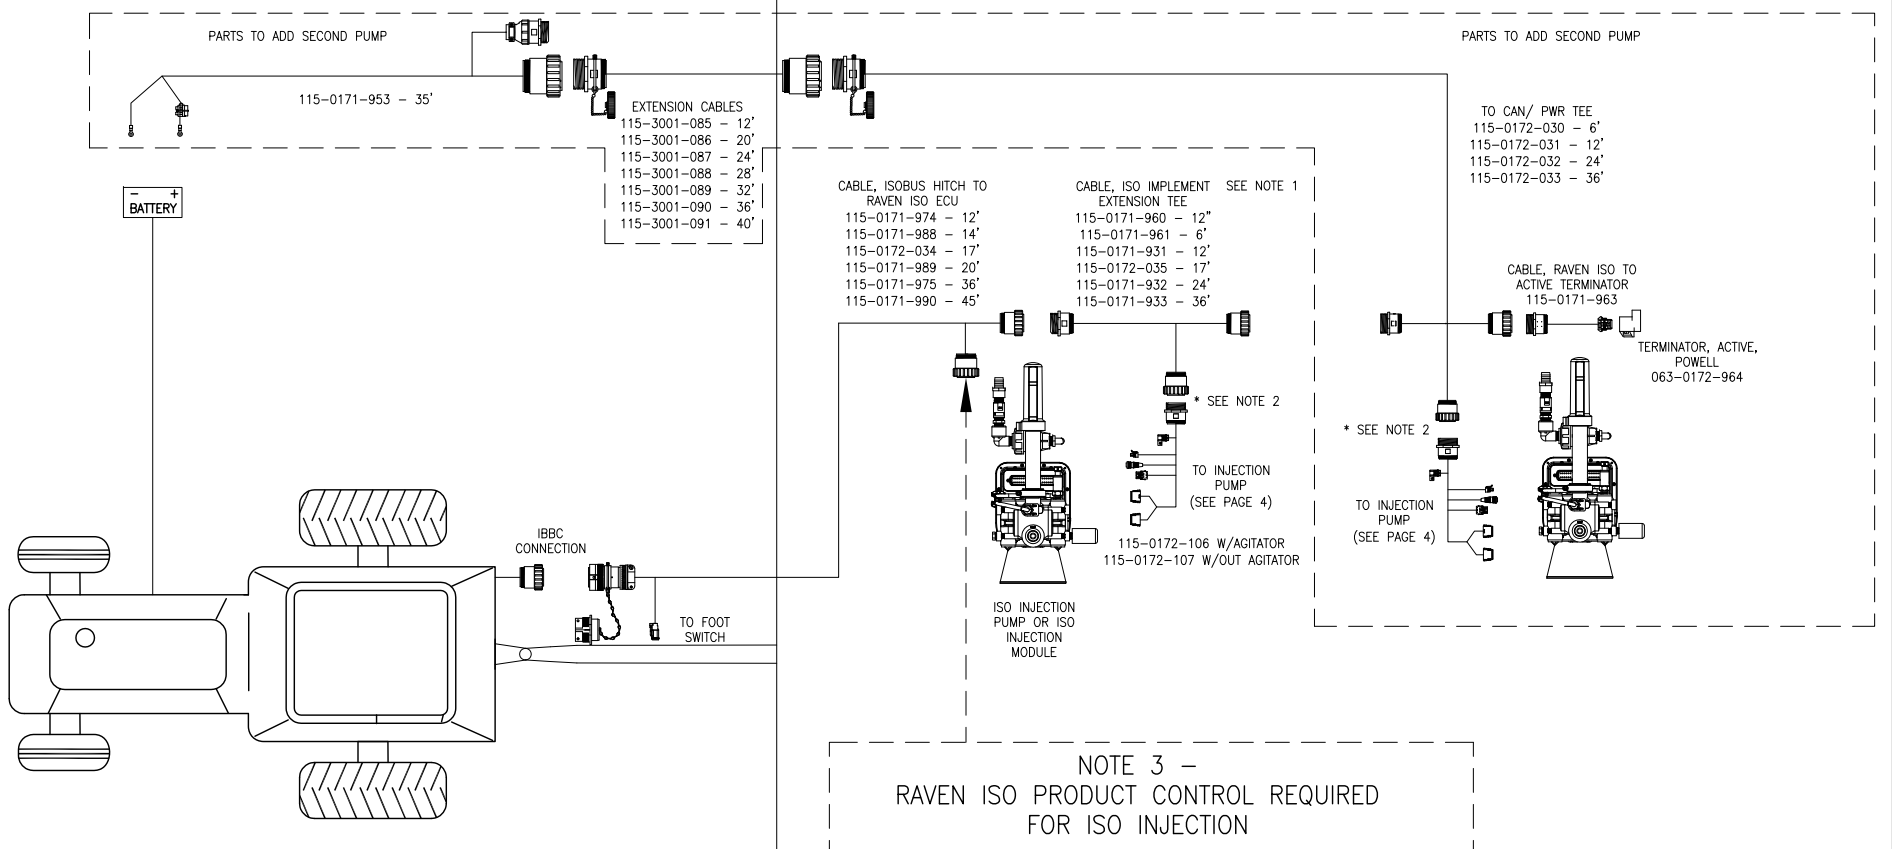


- NOTES:**
1. IF ELECTRICAL LOAD IS MORE THAN 30 AMPS REFER TO PARTS REQUIRED TO ADD SECOND INJECTION PUMP.
 2. NO EXTENSION CABLE ALLOWED
 3. SEE RAVEN ISO PRODUCT CONTROL DRAWINGS.

IMPLEMENT

RELEASED DATE	ECO NO.	PROD. MGR.	SERV.	PROD. CHAMP.	ENG.	DRAFT.	REV.	DRAWING NO.
7/19/12	E19867	JAB	AT	GLE	NAP	AJK2	C	054-6100-006
6/5/13	E21514	GLE	AT	BAY	TET	JJP	D	054-6100-006


JOHN DEERE GREENSTAR RATE CONTROL (GRC) WITH RAVEN ISO INJECTION

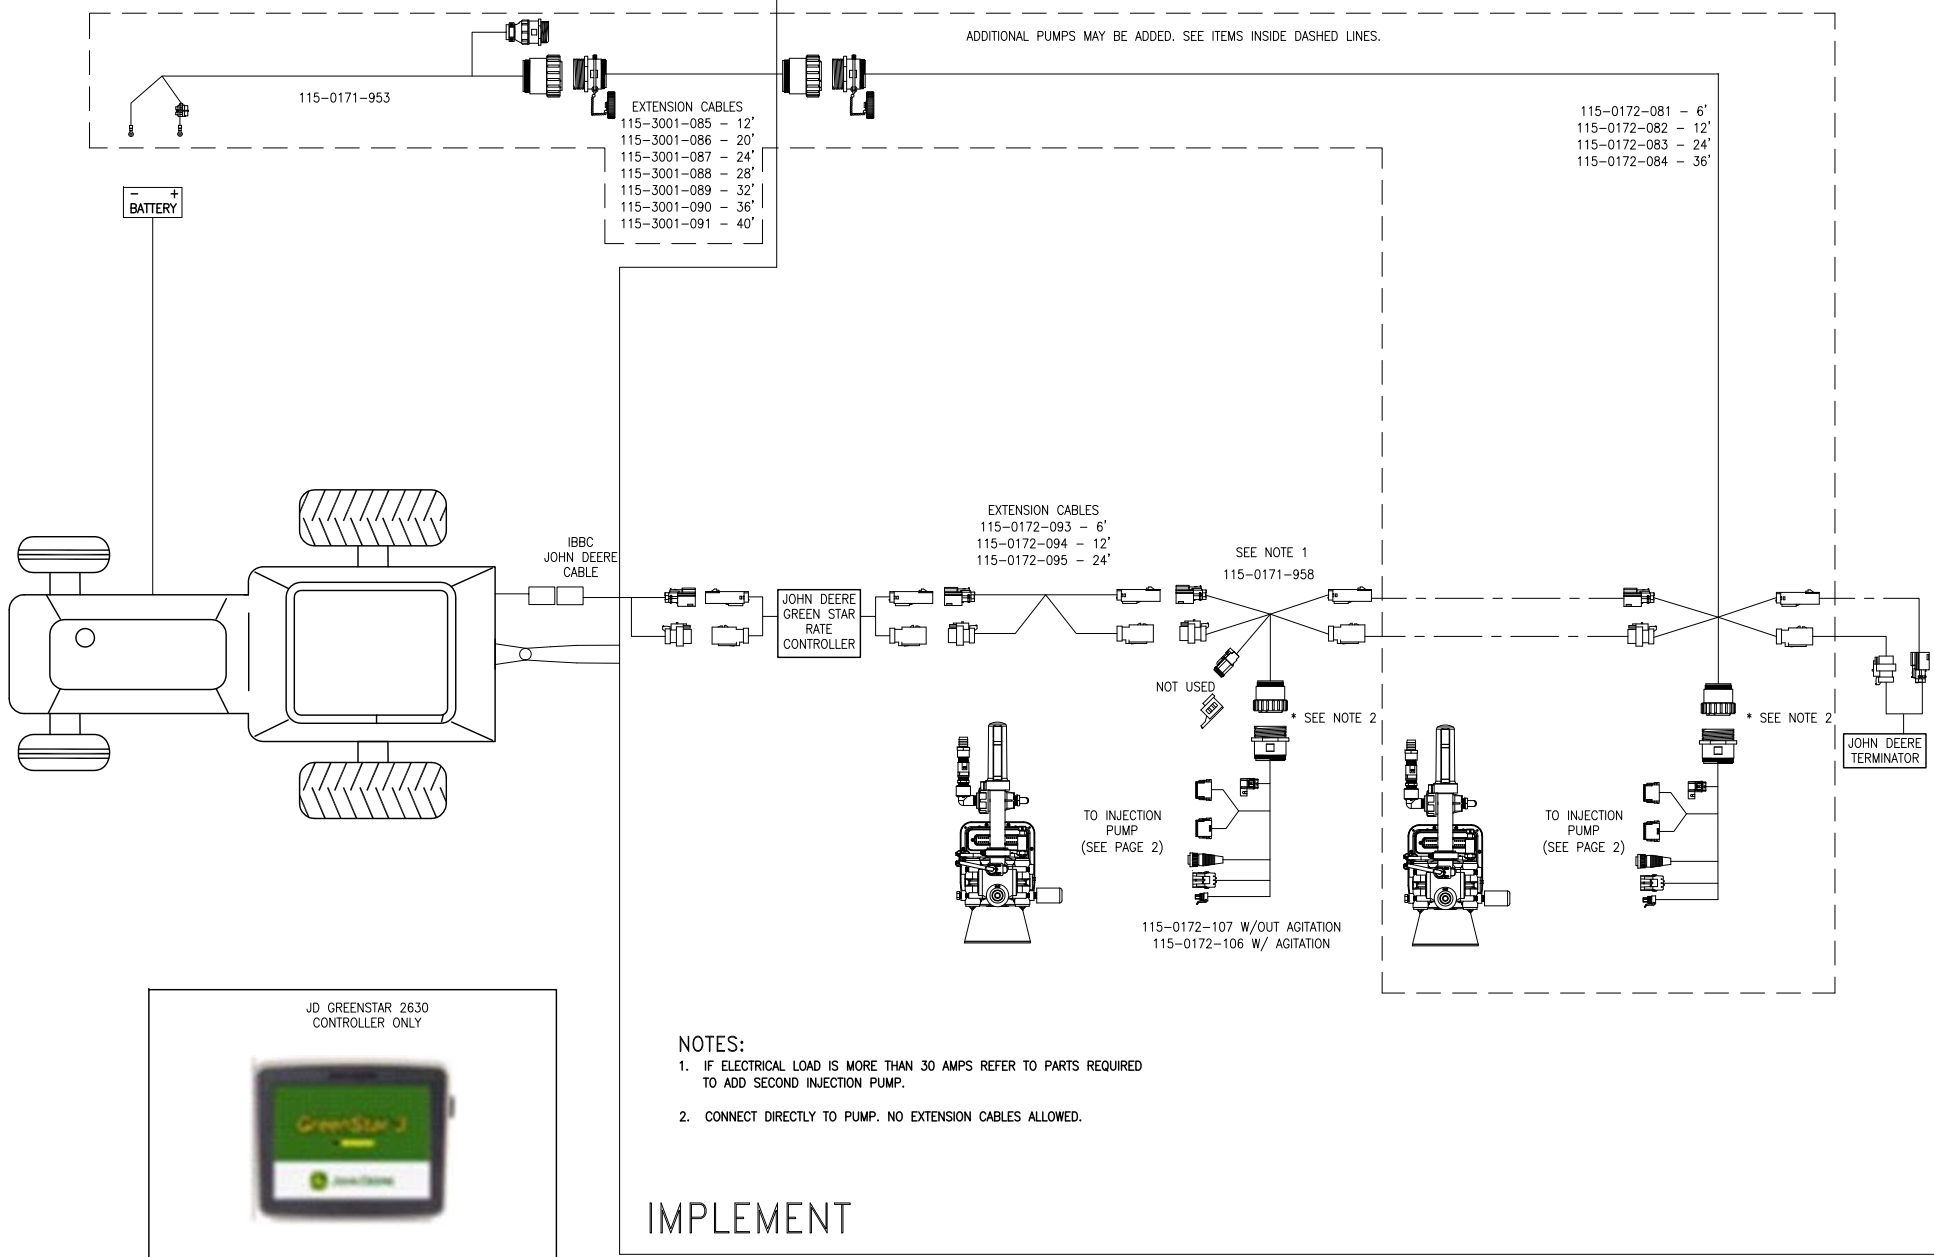

- NOTES:**
1. IF ELECTRICAL LOAD IS MORE THAN 30 AMPS REFER TO PARTS REQUIRED TO ADD SECOND INJECTION PUMP.
 2. CONNECT DIRECTLY TO PUMP. NO EXTENSION CABLES ALLOWED.

RELEASED DATE	ECO NO.	PROD. MGR.	SERV.	PROD. CHAMP.	ENG.	DRAFT.	REV.	DRAWING NO.
7/19/12	E19867	JAB	AT	GLE	NAP	AJK2	C	054-6100-006
6/5/13	E21514	GLE	AT	BAY	TET	JJP	D	054-6100-006

ISO, DIRECT CHEMICAL INJECTION

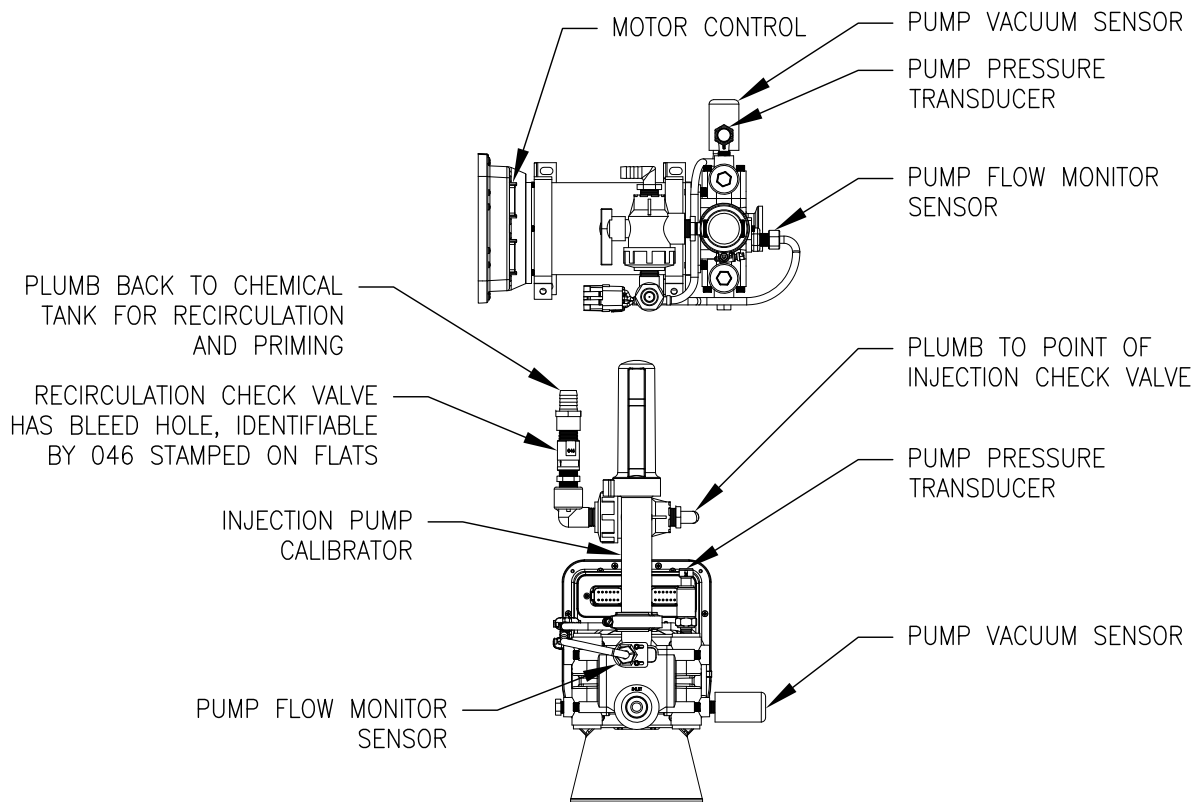

NOTE *****
 ISO PUMPS ARE NOT INTERCHANGEABLE WITH SIDEKICK PRO, OR DEERE SPECIFIC INJECTION ON SELF PROPELLED SPRAYERS


SELECT ISO PUMP/MODULE KIT:

- | | |
|---|--------------|
| 1. KIT, INJECTION W/ CALIBRATOR, 1-40 OZ/MIN: | 063-0173-420 |
| 2. KIT, INJECTION W/ CALIBRATOR, 5-200 OZ/MIN: | 063-0173-421 |
| 3. KIT, INJECTION MODULE W/ CALIBRATOR, 24 GAL, 1-40 OZ/MIN: | 063-0173-422 |
| 4. KIT, INJECTION MODULE W/ CALIBRATOR, 24 GAL, 5-200 OZ/MIN: | 063-0173-423 |

RELEASED DATE	ECO NO.	PROD. MGR.	SERV.	PROD. CHAMP.	ENG.	DRAFT.	REV.	DRAWING NO.
7/19/12	E19867	JAB	AT	GLE	NAP	AJK2	C	054-6100-006
6/5/13	E21514	GLE	AT	BAY	TET	JJP	D	054-6100-006

PLUMBING DIAGRAM

* SEE PRICE BOOK PAGES FOR PART NUMBERS

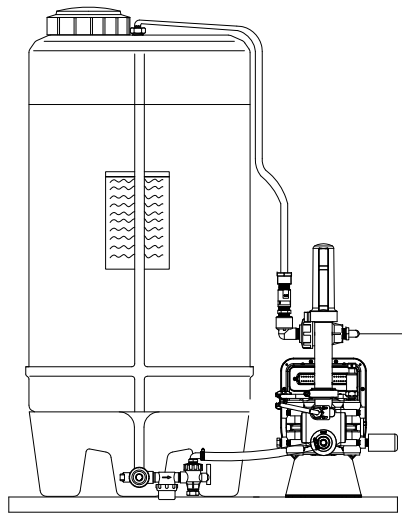

BASIC SPRAYER CARRIER WITH INJECTION ADDED



CARRIER TANK

* PRESSURE RELIEF VALVE

TANK SHUTOFF HAND VALVE

PUMP

STRAINER

INJECTION POINT CHECK VALVE (NOT INCLUDED)

INJECTION POINT PRESSURE TRANSDUCER (OPTIONAL)

INLINE MIXER WITH CARRIER CHECK VALVE

RELEASED DATE	ECO NO.	PROD. MGR.	SERV.	PROD. CHAMP.	ENG.	DRAFT.	REV.	DRAWING NO.
7/19/12	E19867	JAB	AT	GLE	NAP	AJK2	C	054-6100-006
6/5/13	E21514	GLE	AT	BAY	TET	JJP	D	054-6100-006